


Minimum 2 coats of Sika BlackSeal Elastic applied to primed substrate - taken 150 mm onto pipe. (Primer Coat: 1 Part Sika Blackseal Elastic : 1 Part fresh clean potable water, applied at 4m² / litre.)

Sikaswell Profile bonded with Sikaswell S-2 ensuring 80mm reinforced concrete cover in all directions

200 mm wide Sika Deckweb Mesh bedded into first undiluted coat of Sika BlackSeal Elastic (100 mm up wall and 100 mm along pipe)

900_NZ_020706_W008C_2503 en_NZ_03_2025

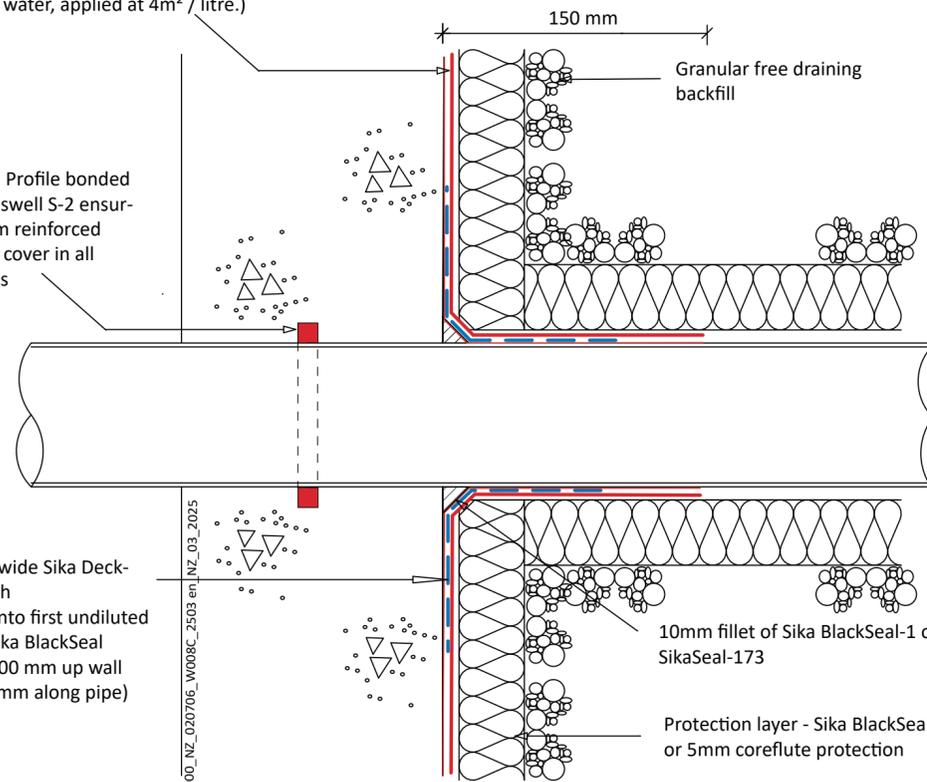

For drainage and backfilling requirements, please refer to the Sika BlackSeal Elastic BRANZ Appraisal No. 770.

Notes:

1. Pipe penetration shall be made watertight prior to the application of Sika BlackSeal Elastic
2. Pipe shall be prepared by abrading and then solvent wiping prior to application of Sika BlackSeal Elastic.

Sika BlackSeal Elastic
Concrete insitu wall / precast wall - cast in pipe penetration

General Detail. Not to scale.

DRAWING MUST ALWAYS BE REVIEWED BY A DESIGN SPECIALIST AND IF NECESSARY MODIFIED TO ENSURE SUITABILITY FOR THE SPECIFIC APPLICATION
The information contained herein and any other advice are given in good faith based on Sika's current knowledge and experience of the products when properly stored, handled and applied under normal conditions in accordance with Sika's recommendations. The information only applies to the application(s) and product(s) expressly referred to herein and is based on laboratory tests which do not replace practical tests. In case of changes in the parameters of the application, such as changes in substrates etc., or in case of a different application, consult Sika's Technical Service prior to using Sika products. The information contained herein does not relieve the user of the products from testing them for the intended application and purpose. All orders are accepted subject to our current terms of sale and delivery. Users must always refer to the most recent issue of the local Product Data Sheet for the product concerned, copies of which will be supplied on request.

900_NZ_020706_W008C_2503 en_NZ_03_2025
March 2025

Sika (NZ) Ltd
85-91 Patiki Rd, Avondale
Auckland 1026
New Zealand
Tel: 0800 745 269
www.sika.co.nz

BUILDING TRUST

